

FLUSHING FLOOR DRAIN



Approval Date

Customer Approval


Job Location

Job Name

Wade Division / Tyler Pipe Assumes No Responsibility For Superseded or Voided Data

9300

A.R.E. COATED CAST IRON FLOOR DRAIN WITH FLUSHING CONNECTION, SATIN FINISH NICKEL BRONZE TOP WITH PERFORATED HINGED GRATE AND BOTTOM OUTLET.
INSTALLATION INSTRUCTIONS

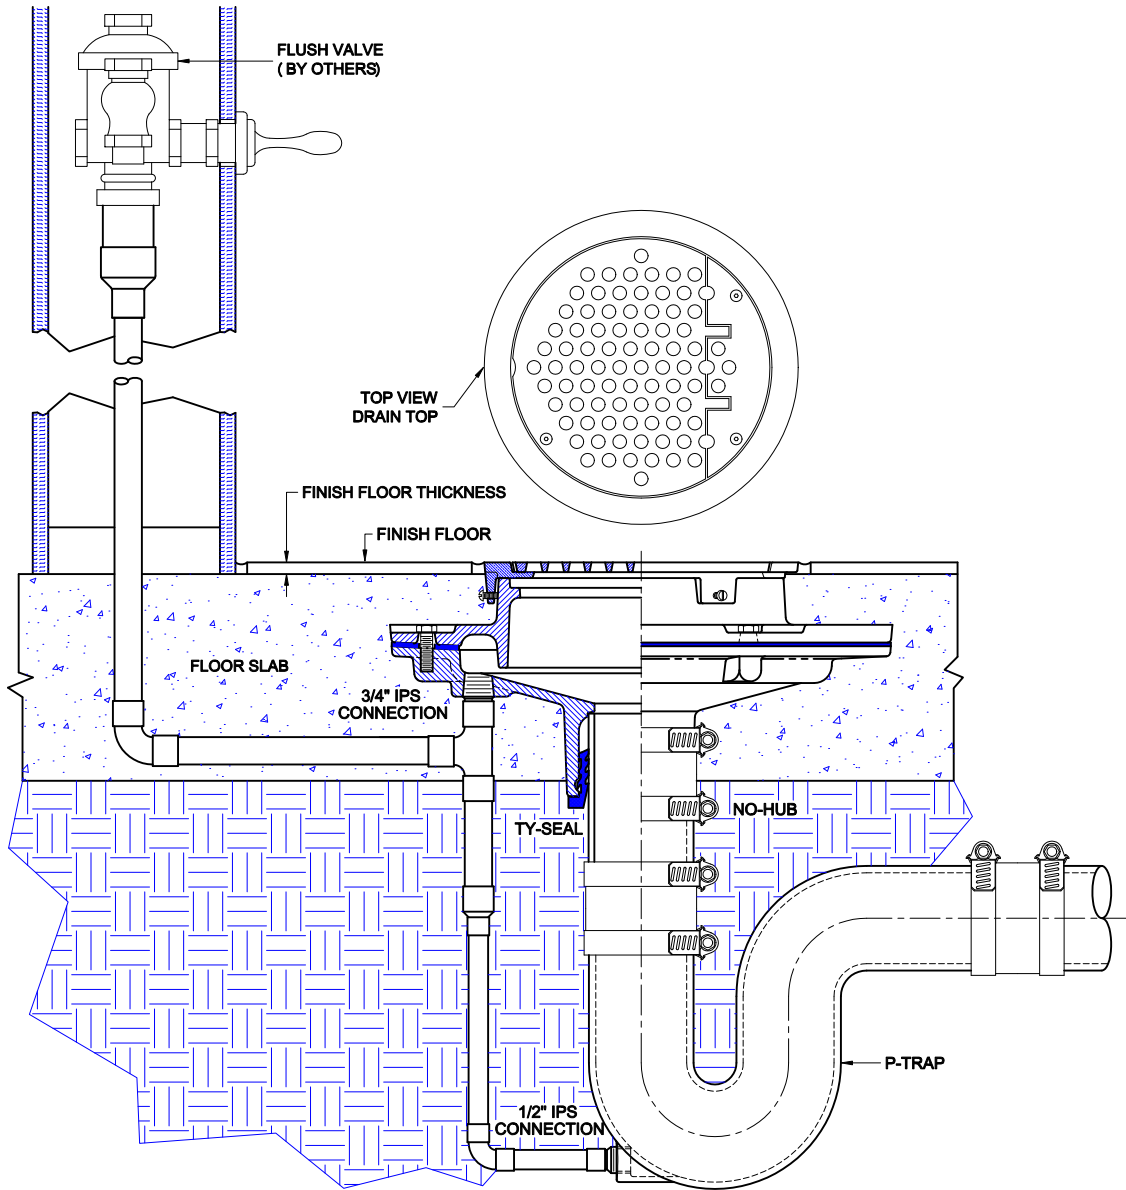

The Wade 9300 Flushing floor drain is for various floor construction methods. The 9300 drain is typically installed in hospital operating rooms, cystoscopic and animal rooms where undesirable waste must be flushed. This drain is particularly suited for industrial and university laboratories and other facilities as an in floor water closet. A flushing connection is provided and is connected to a water supply box or flush valve to purge the sump to prevent contamination. The drain piping is first run to an elevation below the expected finish floor level. The piping must include a p-trap. A flushing connection on the p-trap is recommended. The drain body is secured to the pipe with with any of three connections; No-Hub, Inside Caulk, or Push-On Ty-Seal. The type of connection must be specified upon ordering any Wade Drain. If the Ty-Seal connection is specified, apply Tyler Ty-Seal lubricant to the inside surfaces of the gasket and then firmly push the drain body onto the pipe until it contacts the pipe stop in the body. No-Hub outlets should be installed with Tyler or Anaco/Husky couplings and secured with a torque wrench to the manufacturers recommendations. Inside Caulk connections should follow standard industry practices. Once the body is connected to the pipe, the concrete slab is poured to an elevation level with the top of drain body. For finish floor installation such as tile, the top of the drain should extend above the structural slab the dimension of the thickness of the floor material. Care must be taken to protect the top during installation. Use either cardboard, tape or other protective materials.

AutoCad.dwg

FLUSHING FLOOR DRAIN



Approval Date

Customer Approval

Job Location

Job Name

Dimensional Data (Inches/mm) are Subject to Manufacturers Tolerance and Change Without Notice. Wade Division / Tyler Pipe Assumes No Responsibility For Superseded or Voided Data

9300

A.R.E. COATED CAST IRON FLOOR DRAIN WITH FLUSHING CONNECTION, SATIN FINISH NICKEL BRONZE TOP WITH PERFORATED HINGED GRATE AND BOTTOM OUTLET.
 INSTALLATION INSTRUCTIONS (w/ 2440 WATER SUPPLY BOX)

